



Monthly Generation Performance Report

August 2024

Introduction

As part of the Transmission and Distribution System Operation and Maintenance Agreement (OMA), LUMA serves as both the operator of the electric grid and as the island's System Operator.

As the Operator of the electric grid, LUMA oversees and maintains the transmission and distribution system that is critical to delivering energy to over 1.5 million Puerto Rican customers.

As the System Operator, LUMA monitors the performance of GeneraPR and other private generators' generation units, implements dispatch of available units, and plans and maintains adequate generation reserve levels to meet customer's energy demands.

While LUMA does not generate energy, LUMA's responsibility as the System Operator includes measuring the performance of the island's generation fleet. This report summarizes generation performance, identifies trends, compares facility performance, and provides a high-level picture of the entire generation portfolio.



Table of Contents

Executive Summary

Operations

- System Level Performance
 - System Reserve Status
 - System Heat Rate
 - System Availability
- Plant/Unit Level Performance
 - Available Capacity
 - Heat Rate
 - Generation and Capacity Factor
 - Planned Outage Hours
 - Maintenance Outage Hours
 - Forced Outage Hours
 - Renewables Capacity Factor

Economics

- Fuel Prices
- Fuel Production Costs

About This Report

- Glossary of Terms
- Plant and Unit List



Executive Summary – August Performance

Overview

The maximum peak demand for August 2024 was approximately 3151 MW.

San Juan 7 (100 MW) is out of service and the expected date to return to service is September 1st. Aguirre 2 (450 MW) is currently out of service since August 16th and does not have an expected return date yet. Palo Seco 4 (216 MW) is expected to return to service by June 5, 2025.

Major Events

In August, the electric system experienced 17 generation events that led to load shedding, with 8 caused by underfrequency due to multiple generation unit trips and 9 caused by generation shortfall during peak hours of demand.

For August, the hourly reserve levels averaged 757 MW, with 374 hours during the month having less than 750 MW in reserves (equal to 50% of the time.)

The forecast for September 2024 shows more reserve levels to the same month last year (September 2023), with 830 MW average reserves forecasted versus 614 MW seen for the same month last year.


The System Availability for the month of August was 50%.

- Genera – 50%
- AES – 92%
- EcoEléctrica – 45%

System Reserves

System Reserves is the amount of generating capacity available to meet peak or abnormally high demands for power and to generate power during scheduled or unscheduled outages.

Target: ▲ Reserves >750MW per the System Operation Principles

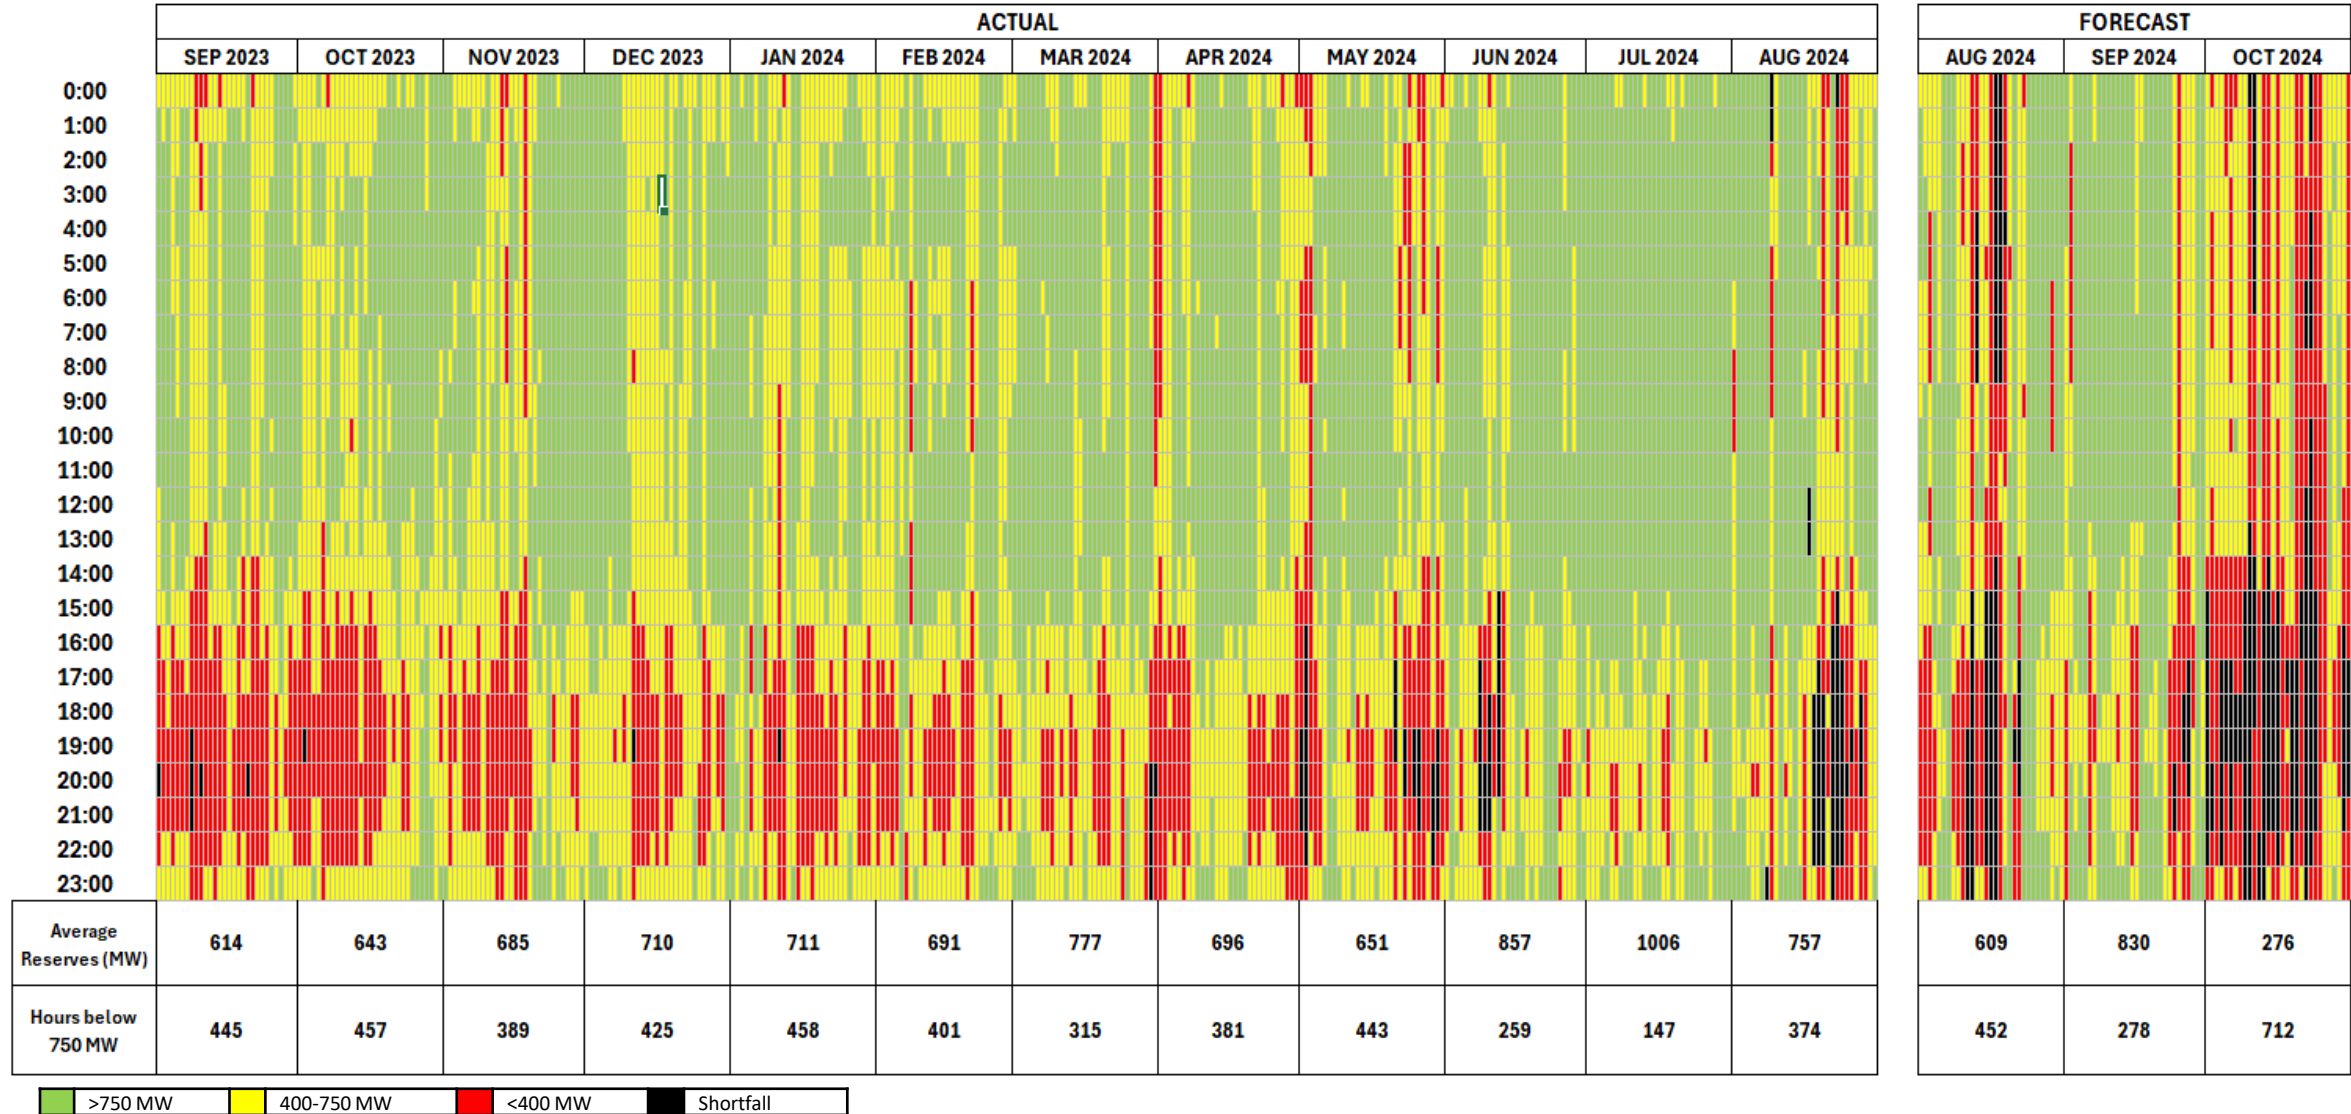


*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

System Availability

The System Availability is the maximum expected output that generating units can supply to system load, adjusted for scheduled or unscheduled outages. In this graph, the availability is being compared with the total generation required to meet demand to visualize the gap between the two lines (the gap represents the reserves level).

Target: ▲ A bigger gap between availability and generation demand means a better chance of recovery in emergency events due to adequate reserves.

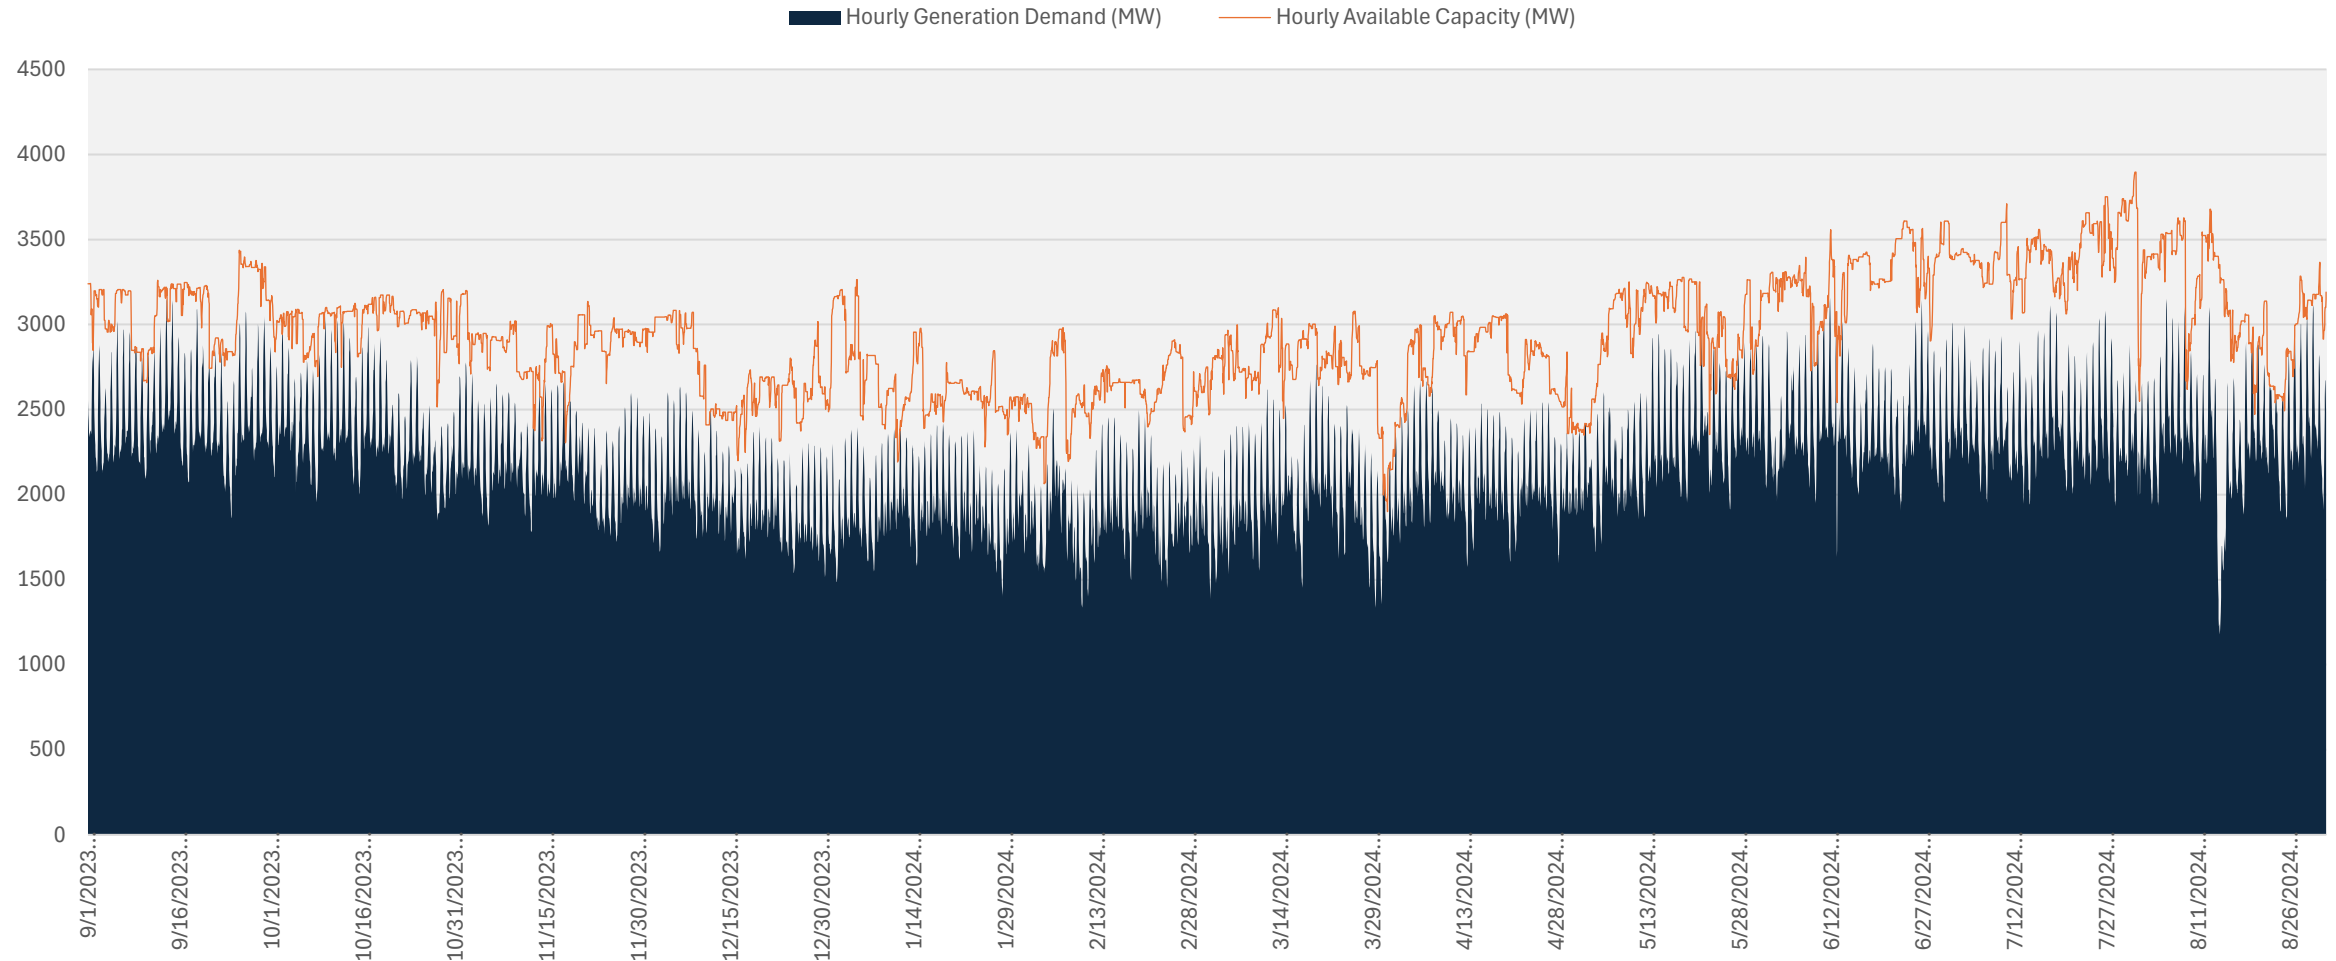


*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Load Shed Events

Load shed events can occur due to unexpected generation unit losses (Unit Performance Load Shed Events). Also, when the demand for electricity exceeds available supply levels, LUMA, as the system operator and in compliance with its responsibilities under the T&D OMA, implements load shedding to stabilize the electric system and prevent larger and longer outages (Generation Shortfall Events).

LUMA does not generate energy and can only operate the system with the electricity that is provided by GeneraPR, PREPA, and other island generators.

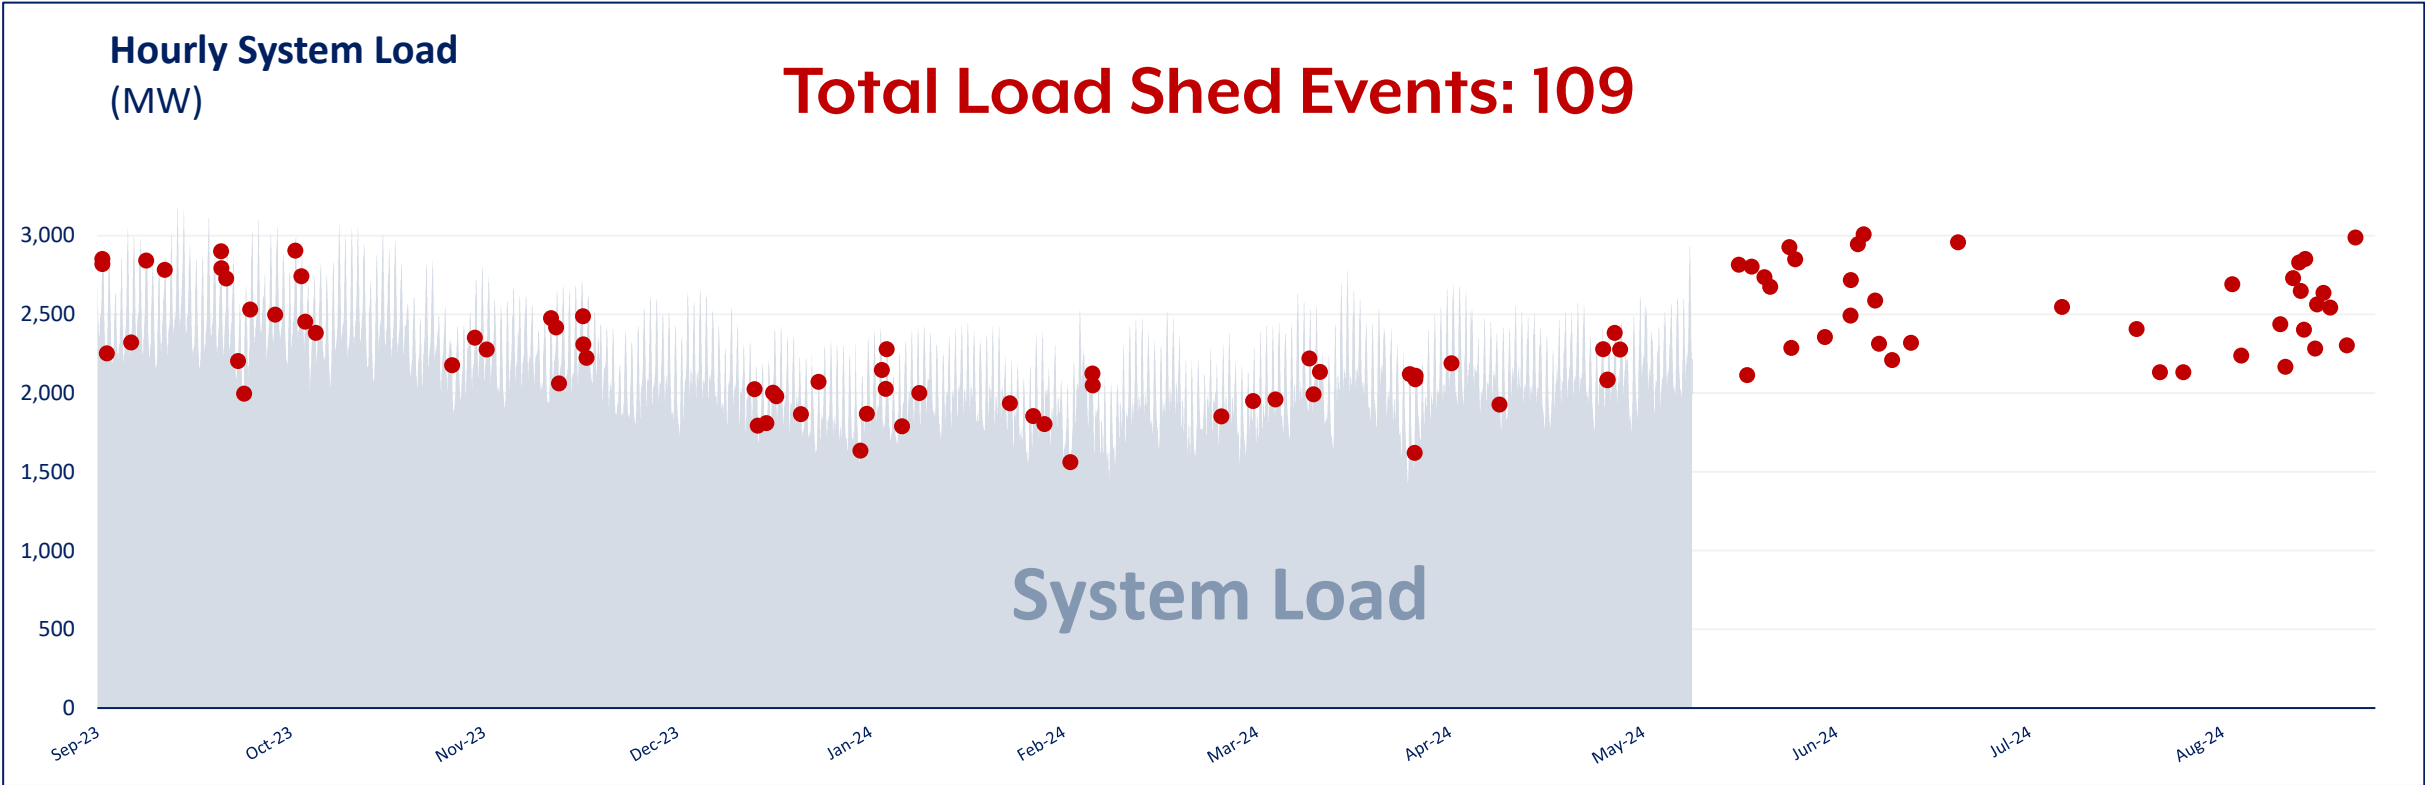

MTD (August 1, 2024 - August 31, 2024)	Total Events	Average Customers Affected	Average Duration (min)	Rolling 12 Months (September 1, 2023 – August 31, 2024)	Total Events	Average Customers Affected	Average Duration (min)
Generation Shortfall Events	9	119,992	63	Generation Shortfall Events	30	92,412	162
Unit Performance Load Shed Events	8	101,187	23	Unit Performance Load Shed Events	78	94,041	23


*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

System Heat Rate

The System Heat Rate measures the efficiency of the system to convert fuel into electricity. System Heat Rate will vary depending on the available generation units and required resources to satisfy electrical demand. It is calculated as energy consumed (MMBtu) / energy produced (MWh). The forecasted Heat Rate is determined by the last forecast calculated for the Fuel Clause Adjustment Factor.

Target: ▼ Lower heat rates represent higher efficiency.

Forecasted vs Actual Heat Rate

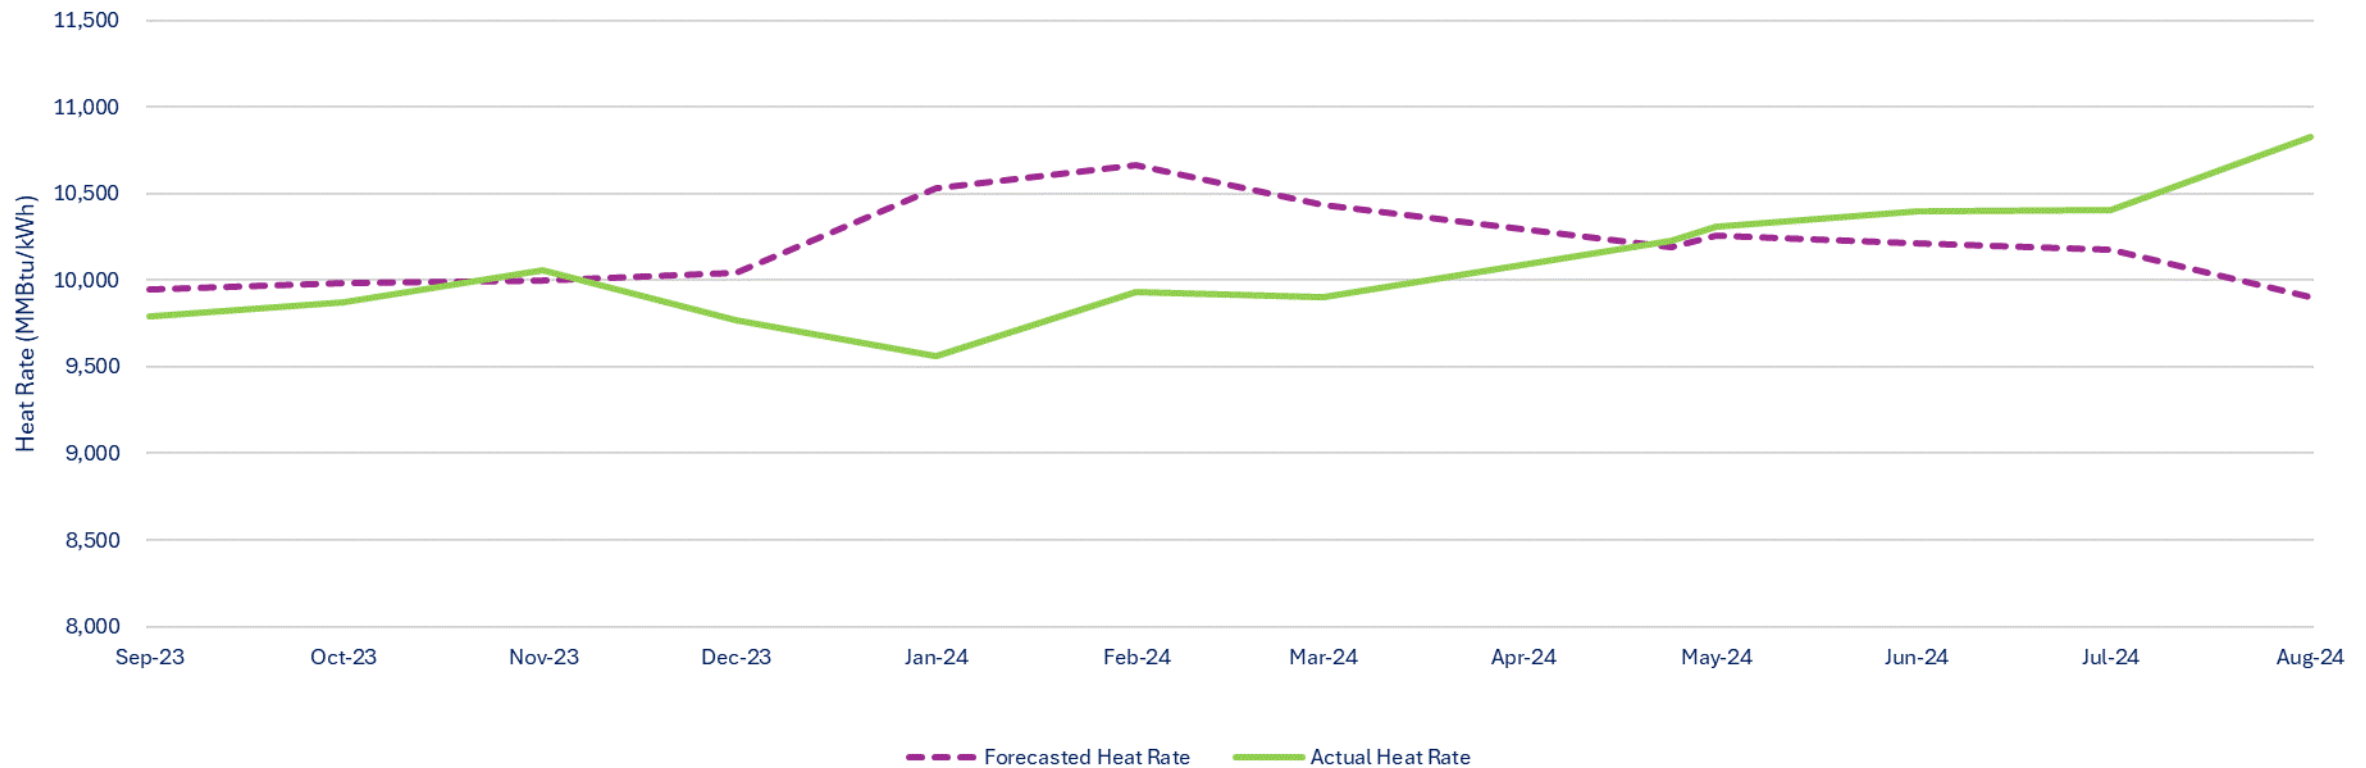








*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Available Capacity – Baseload Units

Available Capacity is the maximum output that a unit can generate at any given time. The Availability Rate indicates the percent of available capacity out of the total nameplate capacity. Variables in the chart below are shown in MW (gross) representing an average over the month.

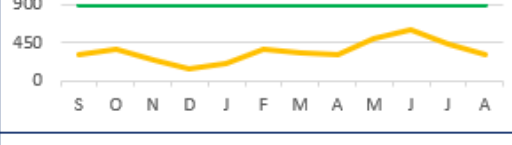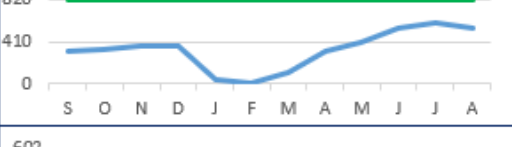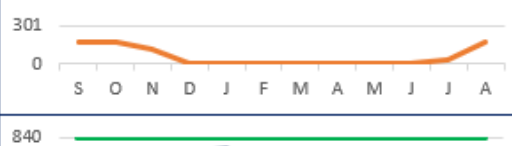Target: ▲ A higher availability indicates the plant is able to produce power closer to its nameplate capacity.









Available Capacity (MW) and Availability Rate (AR)		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	
AES Nameplate Cap: 508		MW	448	243	249	263	370	330	463	406	249	257	440	466
	AR	88%	48%	49%	52%	73%	65%	91%	80%	49%	51%	87%	92%	
EcoElectrica Nameplate Cap: 566		MW	549	550	531	550	550	547	550	550	543	566	566	252
	AR	100%	100%	97%	100%	100%	99%	100%	100%	99%	100%	100%	45%	
Genera Aguirre Nameplate Cap: 900		MW	316	373	257	152	210	368	341	303	505	592	440	314
	AR	35%	41%	29%	17%	23%	41%	38%	34%	56%	66%	49%	35%	
Genera Costa Sur Nameplate Cap: 820		MW	313	333	363	366	48	3	105	316	403	533	599	546
	AR	38%	41%	44%	45%	6%	0%	13%	39%	49%	65%	73%	67%	
Genera Palo Seco Nameplate Cap: 602		MW	168	171	121	0	0	0	0	0	0	0	27	173
	AR	28%	28%	20%	0%	0%	0%	0%	0%	0%	0%	4%	29%	
Genera San Juan Nameplate Cap: 840		MW	690	679	510	652	723	478	585	250	266	337	392	398
	AR	82%	81%	61%	78%	86%	57%	70%	30%	32%	40%	47%	47%	
Total Baseload Nameplate Cap: 4220		MW	2626	2697	2384	2329	2249	2070	2043	1826	1967	2285	2462	2149
	AR	60%	59%	52%	51%	49%	45%	48%	43%	47%	54%	58%	51%	

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Available Capacity – Peaker Units

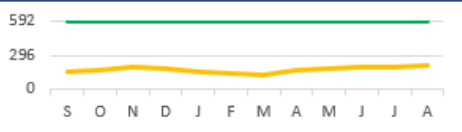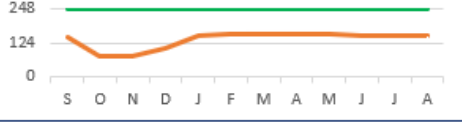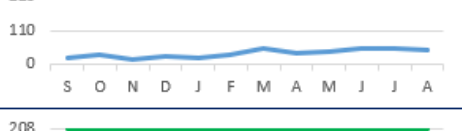Available Capacity is the maximum output that a unit can generate at any given time. The Availability Rate indicates the percent of available capacity out of the total nameplate capacity. Variables in the chart below are shown in MW representing an average over the month.

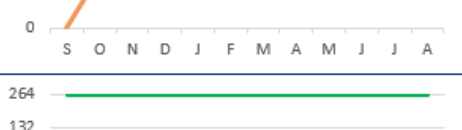Target: ▲ A higher availability indicates the plant is able to produce power closer to its nameplate capacity.

Available Capacity (MW) and Availability Rate (AR)		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	
Genera Aguirre Combined Cvcle Nameplate Cap: 592		MW	148	172	191	185	150	138	127	170	178	201	197	206
	AR	25%	29%	32%	31%	25%	23%	21%	29%	30%	34%	33%	35%	
Genera Cambalache Nameplate Cap: 248		MW	144	74	76	104	152	156	153	155	155	151	151	152
	AR	58%	30%	31%	42%	62%	63%	62%	63%	63%	61%	61%	61%	
Genera Mayaguez Nameplate Cap: 220		MW	20	32	19	26	24	33	50	37	42	53	52	46
	AR	9%	14%	9%	12%	11%	15%	23%	17%	19%	24%	23%	21%	
Genera Palo Seco (Inc. Mobile Pack) Nameplate Cap: 207		MW	178	188	186	182	183	182	176	151	165	153	140	141
	AR	86%	91%	90%	88%	89%	88%	85%	73%	80%	74%	68%	68%	
Palo Seco TM Nameplate Cap: 90		MW	142	148	151	150	147	143	96	62	80	86	84	87
	AR	95%	99%	100%	100%	98%	95%	107%	69%	89%	96%	93%	97%	
San Juan TM Nameplate Cap: 250		MW	0	199	202	196	201	200	205	245	236	226	224	218
	AR	0%	100%	101%	98%	101%	100%	82%	98%	95%	91%	89%	87%	
Other Peakers Nameplate Cap: 264		MW	69	59	62	61	71	68	71	71	60	54	52	51
	AR	26%	22%	24%	23%	27%	26%	27%	27%	23%	21%	20%	19%	
Total Peakers Nameplate Cap: 1871		MW	560	524	535	557	581	577	879	891	917	924	899	900
	AR	37%	34%	35%	36%	38%	38%	47%	48%	49%	49%	48%	48%	


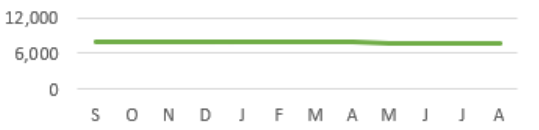
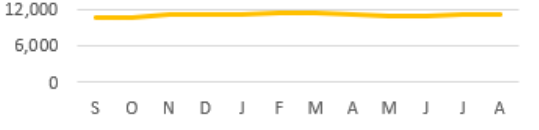



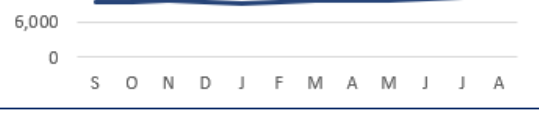
*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.



Heat Rate – Baseload Units

Heat Rate measures the efficiency of a power plant to convert fuel into electricity. It is calculated as energy consumed (MMBtu) / energy produced (MWh).

Target: ▼ Lower heat rates represent higher efficiency.


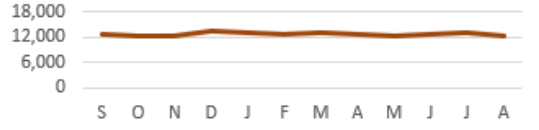

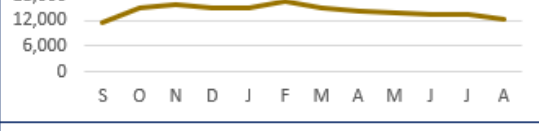



Heat Rate (MMBtu/MWh)		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
AES		9,800	9,800	9,800	9,800	9,800	9,800	10,620	10,620	10,620	10,620	10,620	10,620
EcoElectrica		7,945	7,945	7,945	7,945	7,957	7,957	7,957	7,957	7,881	7,881	7,881	7,881
Genera Aguirre		10,644	10,734	11,008	11,034	11,207	11,397	11,268	11,117	10,934	10,951	11,220	11,225
Genera Costa Sur		10,788	10,887	10,857	10,838	11,323	40,045	11,913	10,397	10,703	10,562	10,343	10,854
Genera Palo Seco		9,813	10,463	10,254	-	-	-	-	-	-	-	10,264	9,696
Genera San Juan		8,477	8,574	9,317	8,956	8,973	9,432	8,714	8,882	8,796	10,188	10,817	11,016
Total Baseload		9,215	9,365	9,477	9,267	8,968	9,381	9,510	9,564	9,687	9,904	10,007	10,275

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Heat Rate – Peaker Units

Heat Rate measures the efficiency of a power plant to convert fuel into electricity. It is calculated as energy consumed (MMBtu) / energy produced (MWh).

Target: ▼ Lower heat rates represent higher efficiency.

Heat Rate (MMBtu/MWh)		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
Genera Aguirre Combined Cycle		14,444	14,811	14,969	14,921	14,671	14,989	13,867	11,936	11,751	12,482	13,852	11,888
Genera Cambalache		12,492	12,341	12,435	13,231	12,834	12,785	12,872	12,640	12,407	12,756	12,876	12,361
Genera Mayaguez		10,824	10,942	10,801	11,013	10,882	10,945	11,029	11,107	10,882	11,040	10,832	10,908
Genera Palo Seco (Inc. Mobile Pack)		11,572	15,072	15,981	14,925	15,146	16,487	15,205	14,397	13,787	13,445	13,662	12,270
Palo Seco TM & San Juan TM		-	-	-	-	-	-	-	11,706	11,137	11,032	10,961	10,983
Other Peakers		14,631	15,086	14,893	14,771	15,064	15,462	14,062	12,730	15,043	14,990	6,912	14,031
Total Peakers		12,578	13,731	13,962	13,195	12,755	12,951	12,710	5,416	6,168	5,087	4,468	6,354

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Generation and Capacity Factor – Baseload Units

Generation indicates the average amount of energy each plant produced per month, in MW (gross). The Capacity Factor measures what percentage of the nameplate capacity was used to produce energy during that time period.

Target: ▲ Higher Capacity Factor, and a Generation closer to the nameplate capacity will represent a better utilization of the units.

Average Generation (MW) and Capacity Factor		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
AES Nameplate Cap: 508		MW 447	242	248	253	355	320	452	412	249	251	437	449
		CF 88%	48%	49%	50%	70%	63%	89%	81%	49%	49%	86%	88%
EcoElectrica Nameplate Cap: 566		MW 434	435	403	410	412	405	398	412	399	415	412	235
		CF 79%	79%	73%	75%	75%	74%	72%	75%	73%	73%	73%	42%
Genera Aguirre Nameplate Cap: 900		MW 249	289	190	156	134	284	243	221	418	466	346	237
		CF 28%	32%	21%	17%	15%	32%	27%	25%	46%	52%	38%	26%
Genera Costa Sur Nameplate Cap: 820		MW 281	314	304	291	37	1	101	270	358	486	482	435
		CF 34%	38%	37%	35%	5%	0%	12%	33%	44%	59%	59%	53%
Genera Palo Seco Nameplate Cap: 602		MW 141	147	105	0	0	0	0	0	0	0	28	139
		CF 23%	24%	18%	0%	0%	0%	0%	0%	0%	0%	5%	23%
Genera San Juan Nameplate Cap: 840		MW 462	425	417	397	473	380	380	227	254	306	343	302
		CF 55%	51%	50%	47%	56%	45%	45%	27%	30%	36%	41%	36%
Total Baseload Nameplate Cap: 4370		MW 2161	2204	2024	1858	1763	1735	1573	1542	1679	1924	2047	1798
		CF 49%	48%	44%	41%	39%	38%	37%	37%	40%	46%	49%	43%

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Generation and Capacity Factor – Peaker Units

Generation indicates the average amount of energy each plant produced per month (MW). The Capacity Factor measures what percentage of the nameplate capacity was used to produce energy during that time period.

Target: ▲ Higher Capacity Factor, and a Generation closer to the nameplate capacity will represent a better utilization of the units.

Average Generation (MW) and Capacity Factor			Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
Genera Aguirre Combined Cycle Nameplate Cap: 592		MW	60	74	75	47	49	42	31	79	101	75	48	114
		CF	10%	13%	13%	8%	8%	7%	5%	13%	17%	13%	8%	19%
Genera Cambalache Nameplate Cap: 247.5		MW	84	32	30	18	31	35	24	57	71	37	27	67
		CF	34%	13%	12%	7%	13%	14%	10%	23%	29%	15%	11%	27%
Genera Mayaguez Nameplate Cap: 220		MW	44	32	23	50	77	72	56	79	90	66	49	69
		CF	20%	14%	10%	23%	35%	33%	25%	36%	41%	30%	22%	31%
Genera Palo Seco (Inc. Mobile-Pack) Nameplate Cap: 207		MW	74	26	9	10	9	13	15	14	32	21	10	37
		CF	36%	13%	5%	5%	4%	6%	7%	7%	15%	10%	5%	18%
Palo Seco TM Nameplate Cap: 150		MW	146	150	154	154	151	143	96	66	82	85	60	80
		CF	98%	100%	103%	103%	101%	95%	106%	74%	91%	94%	66%	89%
San Juan TM Nameplate Cap: 200		MW	0	201	202	196	201	201	189	241	222	203	179	180
		CF	0%	100%	101%	98%	101%	101%	76%	96%	89%	81%	71%	72%
Other Peakers (Genera) Nameplate Cap: 264		MW	24	15	23	7	12	9	7	16	22	6	7	14
		CF	9%	6%	9%	3%	5%	3%	3%	6%	8%	2%	3%	5%
Total Peakers Nameplate Cap: 1530.5		MW	286	180	161	131	178	171	418	552	620	494	379	561
		CF	19%	12%	11%	9%	12%	11%	22%	30%	33%	26%	20%	30%










*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Planned Outage Hours – Baseload Units

Planned Outage Hours represents the shutdown of a generating unit or facility for inspection or maintenance, in accordance with an advance schedule; represented in hours. This scoreboard compares the scheduled outage hours with the actual duration of the outage.

Target: ▼ A smaller gap between actuals and planned hours represents a more accurate planification.

	Planned Outage Hours (SEP 2023 - AUG 2024)	Planned Outage Hours	Completed Outage Hours	Notes for In-Progress Planned Outages	Expected Return-to- Service Date
AES		1872	1566		
EcoElectrica		432	0		
Genera Aguirre		2832	0		
Genera Costa Sur		3480	5340		
Genera Palo Seco		12432	96		
Genera San Juan		5808	775		
Total Baseload		26856	7776		

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Maintenance Outage Hours – Baseload Units

Maintenance Outage Hours represent the shutdown of a generating unit or facility for nonemergency reasons or conditions which need repair outside of the advance schedule; represented in hours per unit.

Target: ▼ Less maintenance hours represents more available capacity in the system to meet demand.








Maintenance Outage Hours		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
AES		0	398	288	264	0	0	0	0	24	120	11	0
EcoElectrica		0	0	0	0	0	0	0	0	0	0	0	0
Genera Aguirre		0	0	0	0	0	0	0	0	0	0	0	0
Genera Costa Sur		0	282	283	139	84	53	24	56	43	0	9	0
Genera Palo Seco		0	0	0	0	0	0	0	0	0	0	0	0
Genera San Juan		0	37	136	551	34	48	105	0	30	0	19	0
Total Baseload		0	717	707	954	118	101	129	56	98	120	38	0

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Forced Outage Hours and Rate – Baseload Units

Forced Outage Hours represent the shutdown of a generating unit or facility for emergency reasons or a condition in which the generating equipment is unavailable for load due to an unanticipated breakdown; represented in hours per unit. The Forced Outage Rate represents the percentage of time the unit was in a Forced Outage condition out of the total time the unit was expected to be available.

Target: ▼ Less forced outage hours and a smaller outage rate represents more available capacity in the system to meet demand.

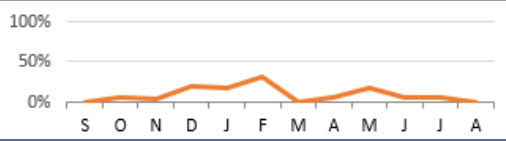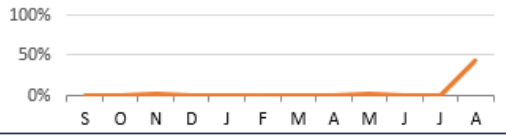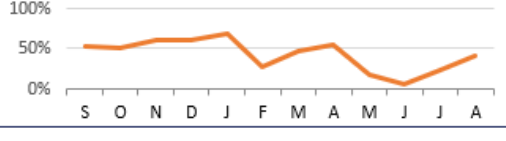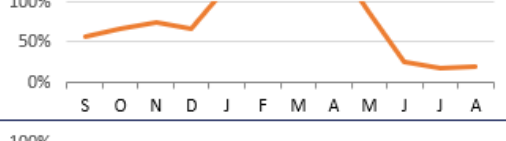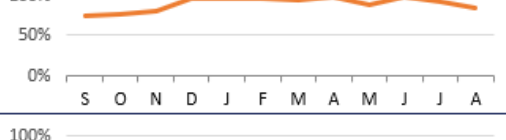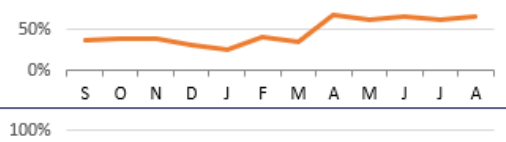







Forced Outage Hours and Outage Rate		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	
AES		Hrs	0	48	24	218	265	432	0	92	166	47	88	0
	%	0%	5%	3%	19%	18%	31%	0%	6%	16%	5%	6%	0%	
EcoElectrica		Hrs	4	0	35	0	0	7	0	0	48	0	0	964
	%	0%	0%	2%	0%	0%	0%	0%	0%	2%	0%	0%	43%	
Genera Aguirre		Hrs	770	743	862	898	1014	370	686	799	250	81	337	609
	%	53%	50%	60%	60%	68%	27%	46%	55%	17%	6%	23%	41%	
Genera Costa Sur		Hrs	795	743	720	720	1391	1356	1021	720	290	134	172	233
	%	57%	66%	74%	67%	119%	128%	115%	152%	85%	24%	18%	19%	
Genera Palo Seco		Hrs	2151	2241	2278	2854	2854	2662	2806	2782	2638	2782	2751	2445
	%	75%	75%	79%	96%	96%	96%	94%	97%	89%	97%	92%	84%	
Genera San Juan		Hrs	2180	2281	2193	1589	1521	2198	1964	3897	3714	3809	3609	3946
	%	38%	39%	39%	30%	26%	41%	35%	68%	63%	66%	62%	66%	
Total Baseload		Hrs	6140	6620	6587	6594	7776	8170	6477	838	8294	6940	6806	8197
	%	31%	24%	25%	25%	28%	32%	41%	6%	53%	46%	44%	52%	

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Renewables Capacity Factor - Solar

The Capacity Factor measures the actual production of electricity over the theoretical maximum output (nameplate capacity). For Renewable projects, the Capacity Factor is expected to be lower due to the solar and wind cycles.

Target: ▲ A higher Capacity Factor represents a better utilization of the maximum capacity the project is able to produce.



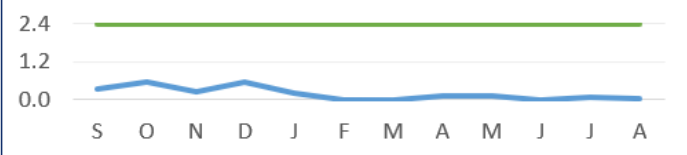
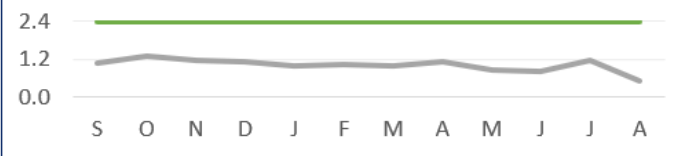

Average Production (MW) and Capacity Factor		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
AES Ilumina		MW	4	3	3	3	4	3	4	4	4	4	4
Nameplate Cap: 20		CF	21%	17%	17%	17%	19%	17%	21%	20%	20%	19%	19%
Windmar Cantera Martínó		MW	0.4	0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.4	0.4	0.3
Nameplate Cap: 2.1		CF	21%	19%	19%	21%	21%	18%	25%	22%	20%	19%	14%
San Fermín		MW	3	2	2	2	2	2	2	1	1	1	2
Nameplate Cap: 20		CF	13%	11%	10%	10%	10%	9%	12%	10%	7%	7%	8%
Horizon Energy		MW	2	2	2	2	2	2	3	3	3	3	3
Nameplate Cap: 10		CF	23%	24%	24%	24%	25%	22%	27%	26%	27%	26%	27%
Oriana Energy		MW	11	10	9	9	10	10	10	11	10	11	10
Nameplate Cap: 45		CF	25%	21%	20%	20%	22%	21%	23%	24%	23%	24%	22%
Windmar Coto Laurel		MW	2	2	2	2	2	2	2	2	1	1	2
Nameplate Cap: 10		CF	22%	18%	17%	17%	16%	16%	19%	19%	18%	15%	16%
Fonroche Humacao		MW	8	6	6	6	7	7	9	8	8	7	9
Nameplate Cap: 40		CF	20%	16%	15%	16%	16%	17%	21%	19%	20%	18%	21%
Total Solar		MW	31	26	25	25	27	26	31	29	29	27	29
Nameplate Cap: 147		CF	21%	18%	17%	17%	18%	17%	21%	20%	19%	18%	20%

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Renewables Capacity Factor – Wind and Landfill

The Capacity Factor measures the actual production of electricity over the theoretical maximum output (nameplate capacity). For Renewable projects, the Capacity Factor is expected to be lower due to the solar and wind cycles.

Target: ▲ A higher Capacity Factor represents a better utilization of the maximum capacity the project is able to produce.

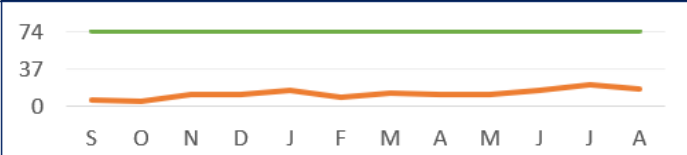
Average Production (MW) and Capacity Factor		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	
Pattern Santa Isabel		MW	6	5	12	12	17	10	13	12	12	16	22	18
Nameplate Cap: 95	S O N D J F M A M J J A	CF	9%	6%	17%	15%	22%	13%	14%	13%	13%	17%	23%	18%
Punta Lima		MW	0	1	3	4	6	4	5	6	3	5	9	6
Nameplate Cap: 26	S O N D J F M A M J J A	CF	0%	4%	11%	17%	25%	14%	20%	25%	12%	20%	33%	23%
Landfill Gas Fajardo		MW	0.3	0.6	0.3	0.5	0.2	0.0	0.0	0.1	0.1	0.0	0.1	0.0
Nameplate Cap: 2.4	S O N D J F M A M J J A	CF	14%	24%	11%	22%	10%	0%	0%	5%	5%	0%	4%	2%
Landfill Gas Toa Baja		MW	1.1	1.3	1.2	1.1	1.0	1.0	1.0	1.1	0.9	0.8	1.2	0.5
Nameplate Cap: 2.4	S O N D J F M A M J J A	CF	45%	55%	49%	46%	42%	43%	41%	47%	36%	33%	48%	21%
Total Wind and Landfill		MW	8	8	17	17	24	14	20	20	16	22	32	24
Nameplate Cap: 80	S O N D J F M A M J J A	CF	7%	7%	16%	17%	23%	14%	16%	16%	13%	18%	25%	19%

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.


Fuel Prices

Fuel Price shows the prices paid for fuel used by PREPA and private generators, both in terms of MMBtus and Barrel of Oil Equivalent (BOE). The Fuel Price is divided by Fuel Type to better illustrate the contribution to the total Fuel Price for the month.

Historical Fuel Price (\$/MMBtu)

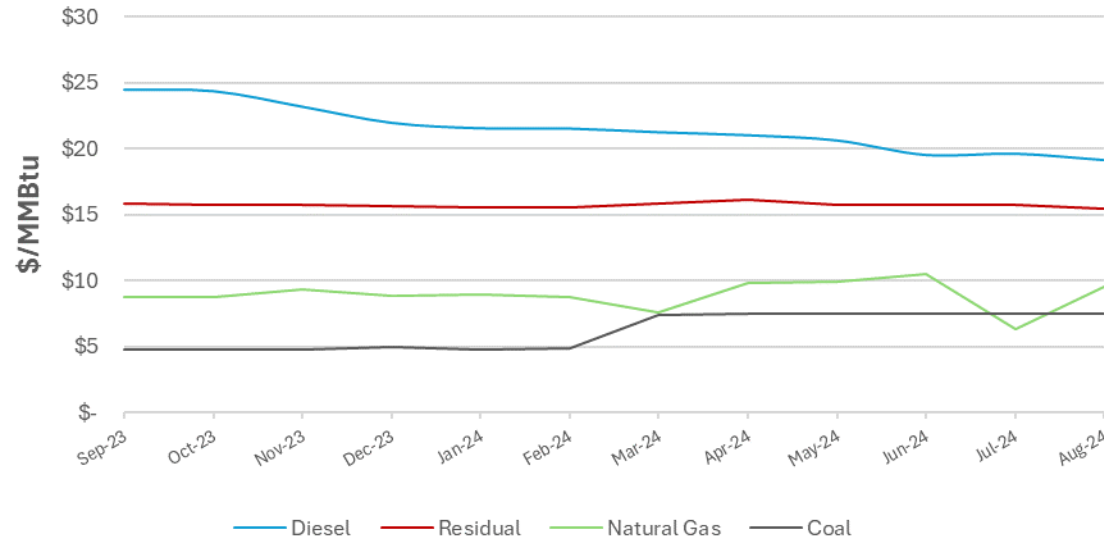

Historical Fuel Price (\$/BOE)

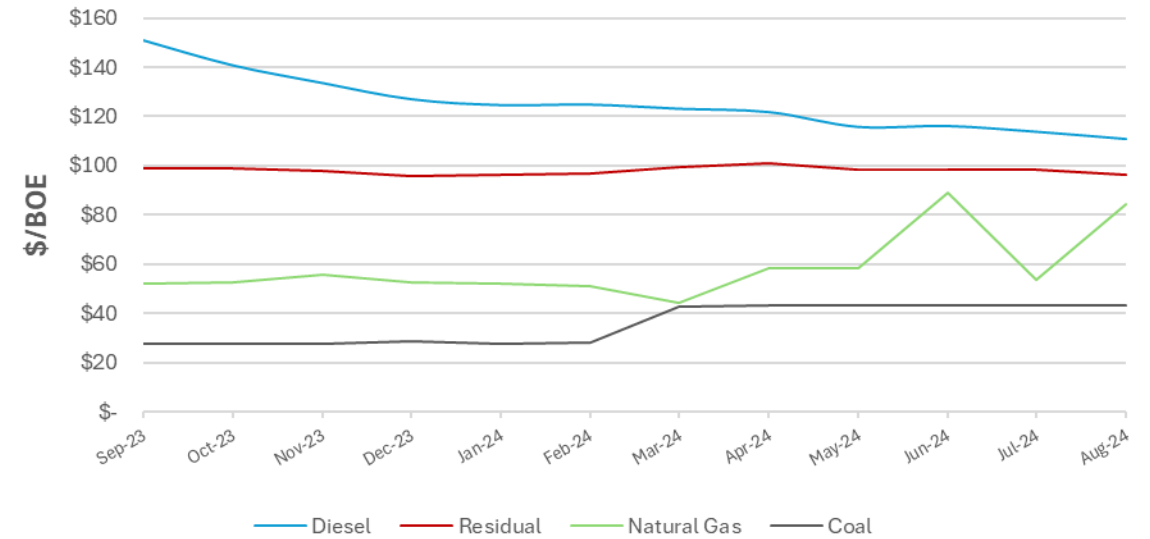


\$/MMBtu		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
Diesel		24.43	24.33	23.15	21.93	21.52	21.50	21.22	21.00	20.60	19.51	19.60	19.12
Residual		15.83	15.77	15.70	15.66	15.57	15.52	15.88	16.18	15.78	15.77	15.77	15.43
Natural Gas		8.72	8.77	9.30	8.87	8.91	8.77	7.59	9.79	9.89	10.49	6.36	9.51
Coal		4.79	4.80	4.80	4.95	4.80	4.85	7.35	7.48	7.48	7.49	7.49	7.49
\$/BOE		Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24
Diesel		151.21	141.06	133.88	127.24	124.84	125.03	123.35	122.01	115.98	116.34	113.98	111.03
Residual		98.81	98.75	98.09	95.89	96.38	96.71	99.35	101.02	98.48	98.47	98.50	96.40
Natural Gas		51.93	52.63	55.73	52.63	51.96	50.94	44.49	58.08	58.06	89.01	53.43	84.35
Coal		27.78	27.86	27.86	28.69	27.85	28.16	42.66	43.41	43.42	43.45	43.45	43.44

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Variable Production Costs

Variable Production Costs are predominantly fuel costs and reflect the cost to produce one MWh of energy. In the graph, the cost is shown separately for Baseload units and Peaker units. The weighted average cost indicates the cost per MWh of energy produced for the System Portfolio.

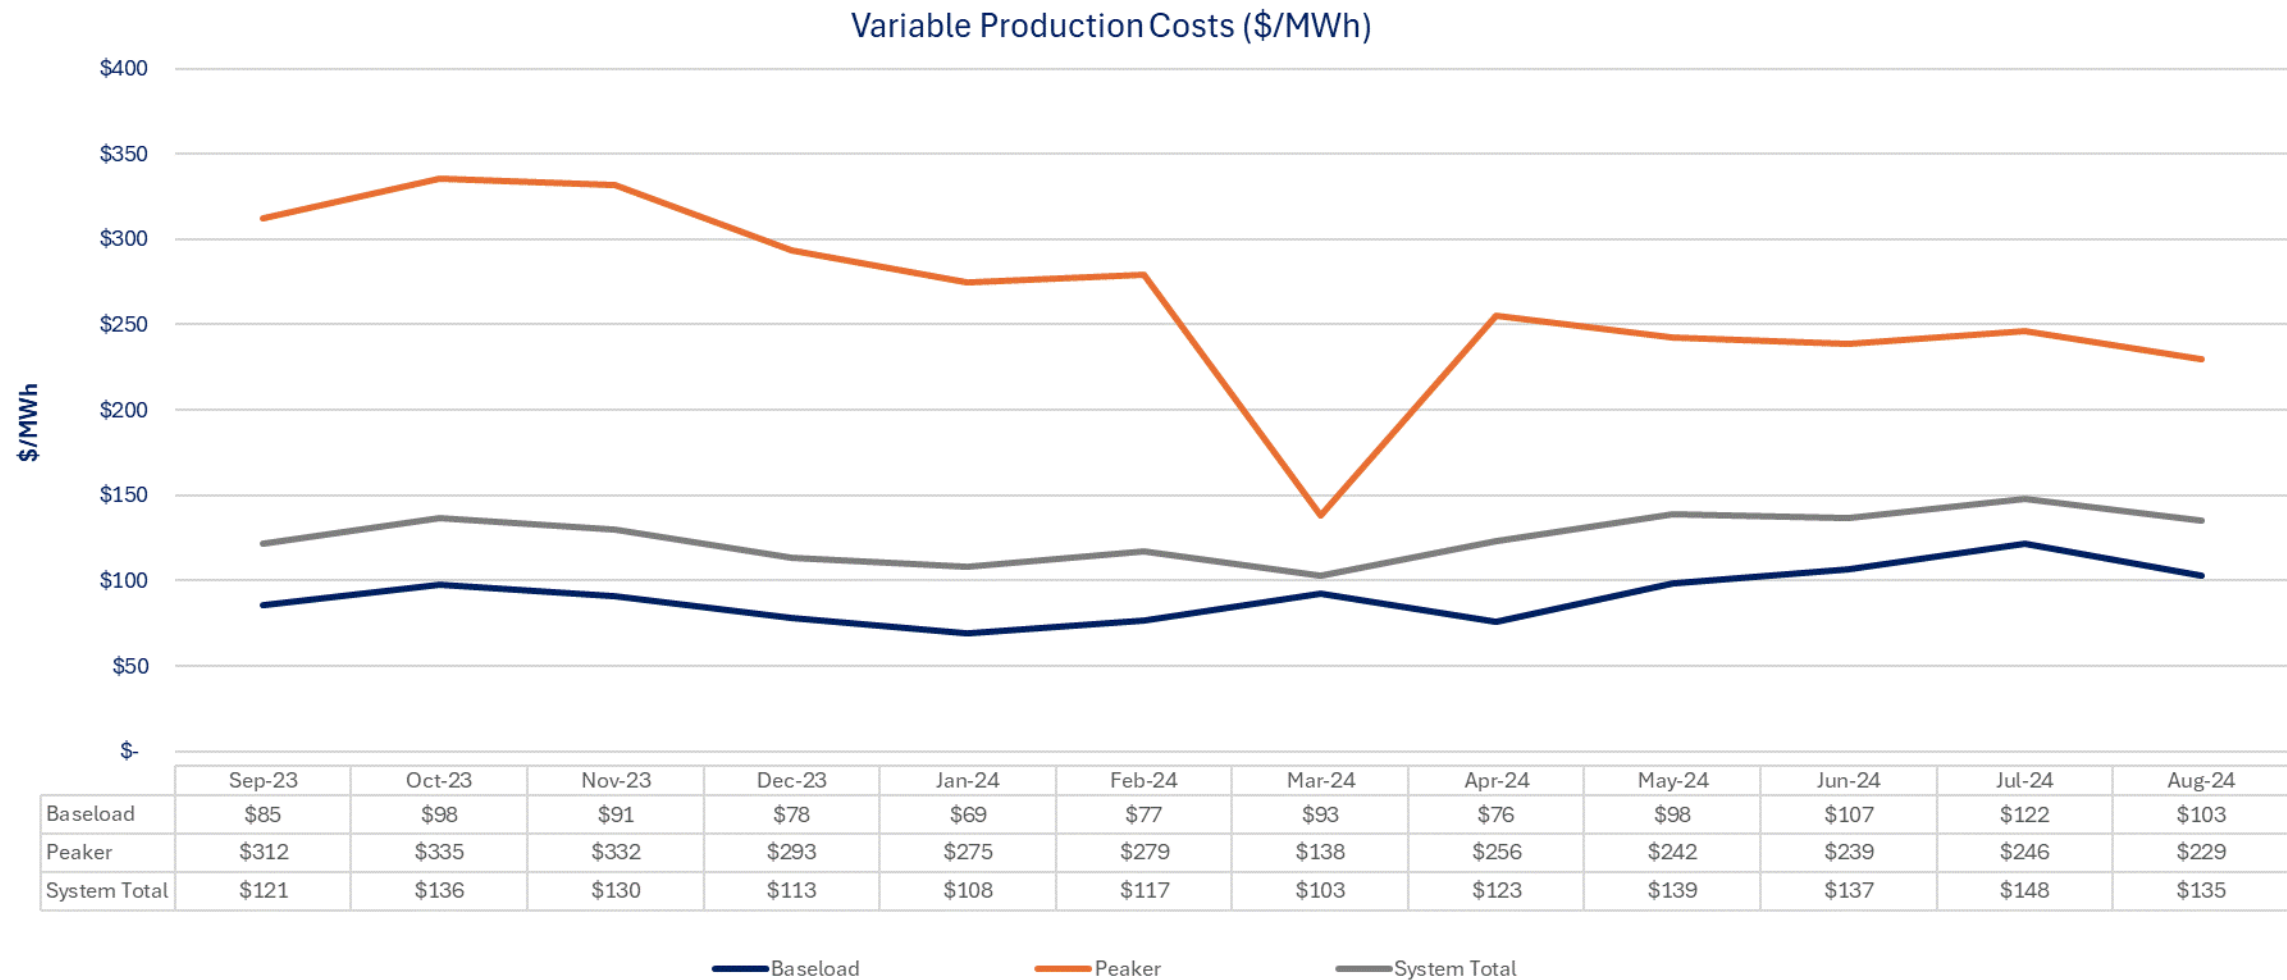

*Refer to Glossary of Terms on page 22 for a list of definitions and formulas.

Glossary of Terms

Term	Definition	Formula
Heat Rate	Measures the efficiency of a power plant to convert fuel into electricity. It is the amount of energy used by a power plant to generate one kilowatt-hour (kWh) of electricity. The more efficient the generator is, the lower the heat rate.	MMBtu consumption by all units in the station during a specific period / MWh produced by the same units in the same period
Reserves	Amount of generating capacity available to meet peak or abnormally high demands for power and to generate power during scheduled or unscheduled outages.	Available Capacity (MW) during the reported period minus the Actual Generation (MW) during the same period
Available Capacity	The maximum output, commonly expressed in megawatts (MW), that generating equipment can supply to system load, adjusted for scheduled or unscheduled outages.	N/A – value is provided for each unit
Availability Rate	The ratio of the maximum output that can be supplied to system load for the period of time considered to the nameplate capacity.	Average available capacity for a specific period (MW) / nameplate capacity
Production	The amount of electric energy produced.	N/A – value is provided for each unit
Capacity Factor	The ratio of the electrical energy produced by a generating unit for the period of time considered to the nameplate capacity.	The average energy produced by all units in the plant during a specific period (MWh) / Nameplate capacity for the plant
Planned Outage Hours	The shutdown of a generating unit or facility for inspection or maintenance, in accordance with an advance schedule; represented in hours per unit (Equivalent Planned Outage Hours). Planned Hours – hours provided in the Generation Outage Schedule for the following 90-day outlook. Actual Hours – number of hours a unit was out of service due to a planned outage.	N/A – values is provided for each unit
Maintenance Outage Hours	The shutdown of a generating unit or facility for nonemergency reasons or conditions which need repair outside of the advance schedule; represented in hours per unit.	N/A – value is provided for each unit
Forced Outage Hours	The shutdown of a generating unit or facility for emergency reasons or a condition in which the generating equipment is unavailable for load due to unanticipated breakdown; represented in hours per unit.	N/A – value is provided for each unit
Forced Outage Rate	The ratio of the forced outages hours to the hours the unit was anticipated to be available for the reporting period.	Forced Outage Hours / Period Hours (excluding planned and unplanned outage hours)
Nameplate Capacity	The maximum rated output of a generator, prime mover, or other electric power production equipment under specific conditions designated by the manufacturer.	N/A – value is provided for each unit
Generation Shortfall Events	An event in which customer demand for electricity is unable to be met due to lack of Available Capacity, leading to customers being manually disconnected from the grid.	N/A – Value is all events which occur in a specified time frame
Unit Performance Load Shed Events	An event in which a generating unit has an unanticipated breakdown and causes customers to be automatically disconnected from the grid to prevent potential damage to the system.	N/A – Value is all events which occur in a specified time frame

Plant and Unit List – Baseload and Peaker Units

BASELOAD UNITS

Plant	Units	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
San Juan	CT 5	X	X	X	X		
	STM 5	X	X	X	X		
	CT 6	X	X	X	X		
	STM 6	X	X	X	X		
	7	X	X	X	X		
	8	X	X	X	X		
	9	X	X	X	X		
	10	X	X	X	X		
Costa Sur	5	X	X	X	X		
	6	X	X	X	X		
Aguirre	1	X	X	X	X		
	2	X	X	X	X		
Palo Seco	1	X	X	X	X		
	2	X	X	X	X		
	3	X	X	X	X		
	4	X	X	X	X		
AES	AES 1	X	X	X	X		
	AES 2	X	X	X	X		
EcoEléctrica	ECO 1	X	X	X	X		
	ECO 2	X	X	X	X		
	STM 1	X	X	X	X		

PEAKER UNITS

FEMA Palo Seco	GT 1	X	X			X	
	GT 2	X	X			X	
	GT 4	X	X			X	
	GT 5	X	X			X	
	GT 6	X	X			X	
	GT 7	X	X			X	

PEAKER UNITS

Plant	Units	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
FEMA San Juan	GT 1	X	X			X	
	GT 2	X	X			X	
	GT 3	X	X			X	
	GT 4	X	X			X	
	GT 5	X	X			X	
	GT 6	X	X			X	
	GT 7	X	X			X	
	GT 8	X	X			X	
	GT 9	X	X			X	
	GT 10	X	X			X	
Palo Seco (Inc. Mobile-Pack)	1-1	X	X	X		X	
	1-2	X	X	X		X	
	2-1	X	X	X		X	
	2-2	X	X	X		X	
	3-1	X	X	X		X	
	3-2	X	X	X		X	
	MP 1	X	X	X		X	
	MP 2	X	X	X		X	
	MP 3	X	X	X		X	
	I-1	X	X	X		X	
	I-2	X	X	X		X	
	I-3	X	X	X		X	
	I-4	X	X	X		X	
Aguirre CC	ST-1	X	X	X		X	
	II-1	X	X	X		X	
	II-2	X	X	X		X	
	II-3	X	X	X		X	
	II-4	X	X	X		X	
	ST-2	X	X	X		X	

PEAKER UNITS

Plant	Units	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
Other Peakers	Daguao 1-1	X	X	X		X	
	Daguao 1-2	X	X	X		X	
	Aguirre 2-1	X	X	X		X	
	Aguirre 2-2	X	X	X		X	
	Costa Sur 1-1	X	X	X		X	
	Costa Sur 1-2	X	X	X		X	
	Jobos 1-1	X	X	X		X	
	Jobos 1-2	X	X	X		X	
	Yabucoa 1-1	X	X	X		X	
	Yabucoa 1-2	X	X	X		X	
	Vega Baja 1-1	X	X	X		X	
	Vega Baja 1-2	X	X	X		X	
	Vieques 1	X	X	X		X	
	Vieques 2	X	X	X		X	
	Culebra 1	X	X	X		X	
	Culebra 2	X	X	X		X	
	Culebra 3	X	X	X		X	
Cambalache	1	X	X	X		X	
	2	X	X	X		X	
	3	X	X	X		X	
Mayaguez	1A	X	X	X		X	
	1B	X	X	X		X	
	2A	X	X	X		X	
	2B	X	X	X		X	
	3A	X	X	X		X	
	3B	X	X	X		X	
	4A	X	X	X		X	
	4B	X	X	X		X	

Plant and Unit List – Renewable Projects

SOLAR PROJECTS

Projects	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
AES Ilumina						X
Cantera Martinó						X
San Fermín						X
Horizon Energy						X
Oriana Energy						X
Coto Laurel						X
Humacao						X

WIND AND LANDFILL PROJECTS

Projects	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
Pattern Santa Isabel						X
Punta Lima						X
Landfill Gas Fajardo						X
Landfill Gas Toa Baja						X

HYDRO PLANTS

Projects	System Reserves	System Availability	System Heat Rate	All Metrics for Baseload Units	All Metrics for Peaker Units	Renewables Capacity Factor
Caonillas 1-1						
Caonillas 1-2						
Caonillas 2-1						
Dos Bocas 1						
Dos Bocas 2						
Dos Bocas 3						
Garzas 1-1						
Garzas 1-2						
Garzas 2-1						
Patillas 1-1						
Patillas 1-2						
Rio Blanco 1-1						
Rio Blanco 1-2						
Toro Negro 1-1						
Toro Negro 1-2						
Toro Negro 1-3						
Toro Negro 1-4						
Toro Negro 2-1						
Yauco 1-1						
Yauco 2-1						
Yauco 2-2						