

DAILY GENERATION AVAILABILITY REPORT

LUMA is not responsible for generation and is providing this report as part of service to our customers.

The report shows the availability generation as reported daily by each generator.


3/17/2025

Projected System Availability and Reserves


<div style="font-size: 2em; font-weight: bold; color: #0056b3;">2,437</div> <div style="font-size: 0.8em; color: #0056b3;">PEAK DEMAND</div>	<div style="font-size: 2em; font-weight: bold; color: #0056b3;">650</div> <div style="font-size: 0.8em; color: #0056b3;">REQUIRED RESERVES</div>	<div style="font-size: 2em; font-weight: bold; color: #d9534f;">360</div> <div style="font-size: 0.8em; color: #d9534f;">RESERVES SHORTFALL</div>	Previous Day 3/16/2025			
		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="padding: 5px;">Min. Demand 1,370 MW</td> <td style="padding: 5px;">Time: 1:18 PM</td> </tr> </table>		Min. Demand 1,370 MW	Time: 1:18 PM	
Min. Demand 1,370 MW	Time: 1:18 PM					
<div style="font-size: 2em; font-weight: bold; color: #0056b3;">2,727</div> <div style="font-size: 0.8em; color: #0056b3;">AVAILABLE SUPPLY</div>	<div style="font-size: 2em; font-weight: bold; color: #d9534f;">290</div> <div style="font-size: 0.8em; color: #d9534f;">AVAILABLE RESERVES</div>	<div style="font-size: 2em; font-weight: bold; color: #0056b3;">44%</div> <div style="font-size: 0.8em; color: #0056b3;">AVAILABILITY RATE</div>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="padding: 5px;">Peak Demand 2,330 MW</td> <td style="padding: 5px;">Time: 8:30 PM</td> </tr> </table>		Peak Demand 2,330 MW	Time: 8:30 PM
Peak Demand 2,330 MW	Time: 8:30 PM					
			<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="padding: 5px;">Total Generation 39,154 MWh</td> </tr> </table>		Total Generation 39,154 MWh	
Total Generation 39,154 MWh						

*All units are shown in MW

System Availability and Status

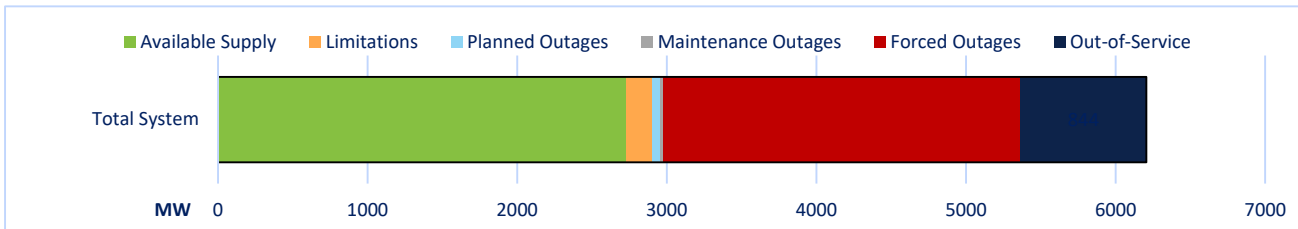

Availability and Status as reported by each Generator

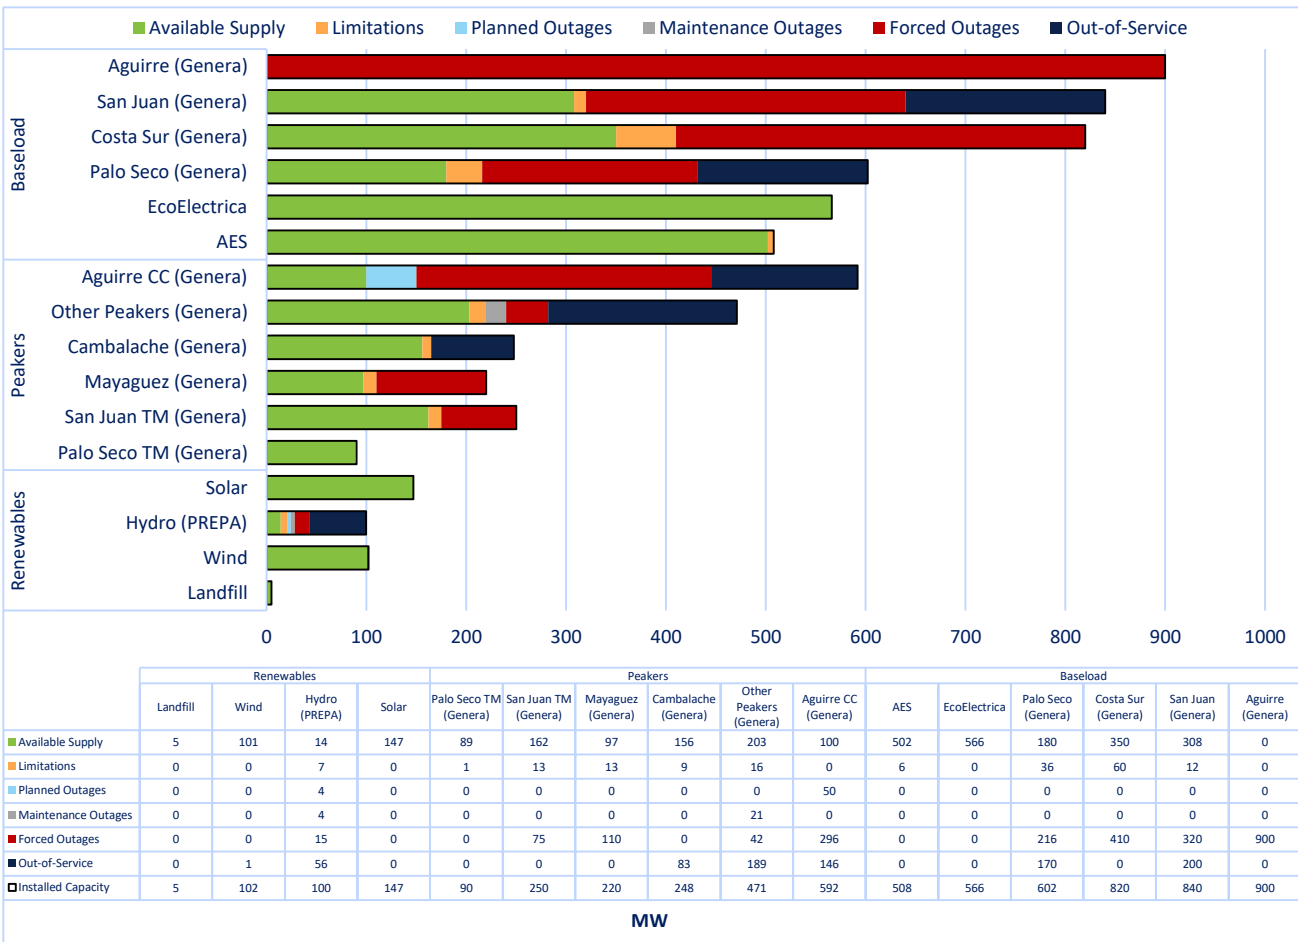

DAILY GENERATION AVAILABILITY REPORT

LUMA is not responsible for generation and is providing this report as part of service to our customers.
The report shows the availability generation as reported daily by each generator.

PLANNED AND MAINTENANCE OUTAGES

Baseload Units														
		■ Scheduled Outage						■ Outage Extension						
Month		J	F	M	A	M	J	J	A	S	O	N	D	
GPR	San Juan CT 5													
	San Juan STM 5													
	San Juan CT 6													
	San Juan STM 6													
	San Juan 7													
	San Juan 8													
	San Juan 9													
	San Juan 10													
	GPR	Palo Seco 1												
		Palo Seco 2												
Palo Seco 3														
Palo Seco 4														
GPR	Costa Sur 5													
	Costa Sur 6													
GPR	Aguirre 1													
	Aguirre 2													
ECO	ECO 1													
	ECO 2													
	ECO STEAM													
AES	AES 1													
	AES 2													

Peaking Units														
		■ Scheduled Outage						■ Outage Extension						
Month		J	F	M	A	M	J	J	A	S	O	N	D	
GPR	Aguirre CC 1-1													
	Aguirre CC 1-2													
	Aguirre CC 1-3													
	Aguirre CC 1-4													
	Aguirre CC STM-1													
	Aguirre CC 2-1													
	Aguirre CC 2-2													
	Aguirre CC 2-3													
	Aguirre CC 2-4													
	Aguirre CC STM-2													
	GPR	Cambalache 1												
		Cambalache 2												
Cambalache 3														
GPR	Mayaguez 1A													
	Mayaguez 1B													
	Mayaguez 2A													
	Mayaguez 2B													
	Mayaguez 3A													
	Mayaguez 3B													
	Mayaguez 4A													
	Mayaguez 4B													

REFERENCED TERMS:

Peak Demand is the anticipated highest demand at a certain point of the day.

The Required Reserves are determined daily depending on the largest unit in the system.

Available Reserves represent the difference between the total electricity available from the generators and the current electricity demand from customers. Reserve levels can change throughout the day as the available electricity from the generators increases or decreases, or depending on the amount of electricity customers are using. Green indicates the Required Reserves will be met; red indicates the reserves will be below the Required Reserve level.

Reserves Shortfall are the difference between the Required Reserves and the Current Reserves.

Available Supply means the available electricity that will be generated by the generators. The Available Supply shown in the System Availability Graphs do not include Solar, Wind, or Landfill.

Availability Rate is calculated as Available Capacity / Nameplate Capacity, where Nameplate Capacity is the maximum output of a generator as designed by the manufacturer.

Limitations represent the reduction of electricity that can be generated by the generators. These Limitations are established by each generator.

Outages represent the reduction of electricity that can be generated by the generators due to the unavailability of a unit, or various units. These outages can be scheduled or unscheduled.

Out-of-Service represents units that have been unavailable for a period of 12 months or longer.