

DAILY GENERATION AVAILABILITY REPORT

LUMA is not responsible for generation and is providing this report as part of service to our customers.

The report shows the availability generation as reported daily by each generator.


11/11/2025

Projected System Availability and Reserves


2,710 PEAK DEMAND	710 REQUIRED RESERVES	301 RESERVES SHORTFALL	Previous Day 11/10/2025	
3,119 AVAILABLE SUPPLY	409 AVAILABLE RESERVES	50% AVAILABILITY RATE	Min. Demand 1,925 MW	Time: 11:00 AM
			Peak Demand 2,757 MW	Time: 6:33 PM
			Total Generation 53,801 MWh	

*All units are shown in MW

System Availability and Status

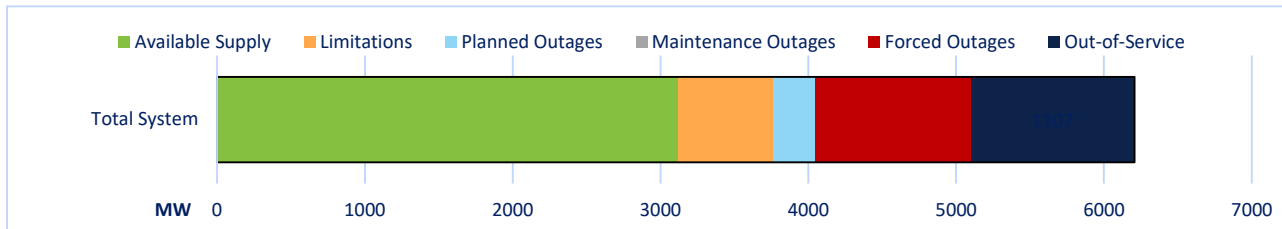

Availability and Status as reported by each Generator

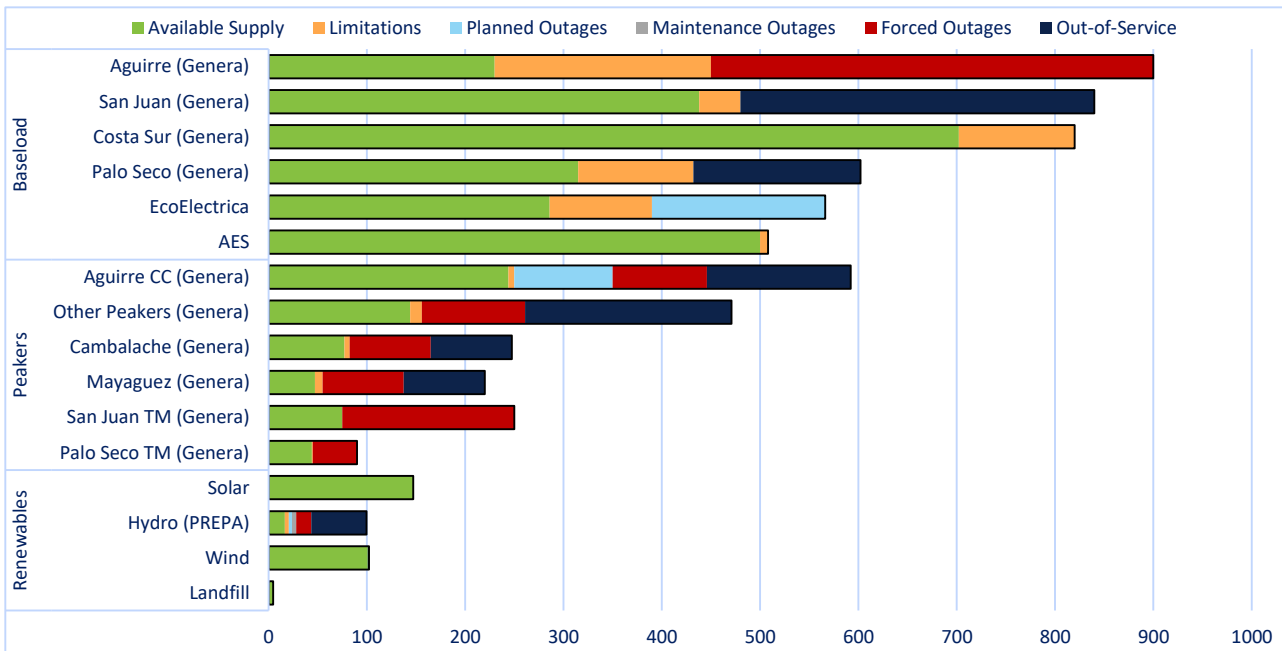

	Renewables				Peakers						Baseload					
	Landfill	Wind	Hydro (PREPA)	Solar	Palo Seco TM (Genera)	San Juan TM (Genera)	Mayaguez (Genera)	Cambalache (Genera)	Other Peakers (Genera)	Aguirre CC (Genera)	AES	EcoElectrica	Palo Seco (Genera)	Costa Sur (Genera)	San Juan (Genera)	Aguirre (Genera)
Available Supply	5	101	17	147	44	75	47	77	144	244	500	286	315	702	438	230
Limitations	0	0	4	0	1	0	8	6	12	6	8	104	117	118	42	220
Planned Outages	0	0	4	0	0	0	0	0	0	100	0	176	0	0	0	0
Maintenance Outages	0	0	4	0	0	0	0	0	0	0	0	0	0	0	0	0
Forced Outages	0	0	15	0	45	175	83	83	105	96	0	0	0	0	0	450
Out-of-Service	0	1	56	0	0	0	83	83	210	146	0	0	170	0	360	0
Installed Capacity	5	102	100	147	90	250	220	248	471	592	508	566	602	820	840	900

MW





DAILY GENERATION AVAILABILITY REPORT

LUMA is not responsible for generation and is providing this report as part of service to our customers.

The report shows the availability generation as reported daily by each generator.

AVAILABILITY AND STATUS BY UNIT AS REPORTED BY EACH FACILITY


■ Available Supply
 ■ Limitations
 ■ Forced Outages
 ■ Maintenance Outages
 ■ Planned Outages
 ■ Out-of-Service

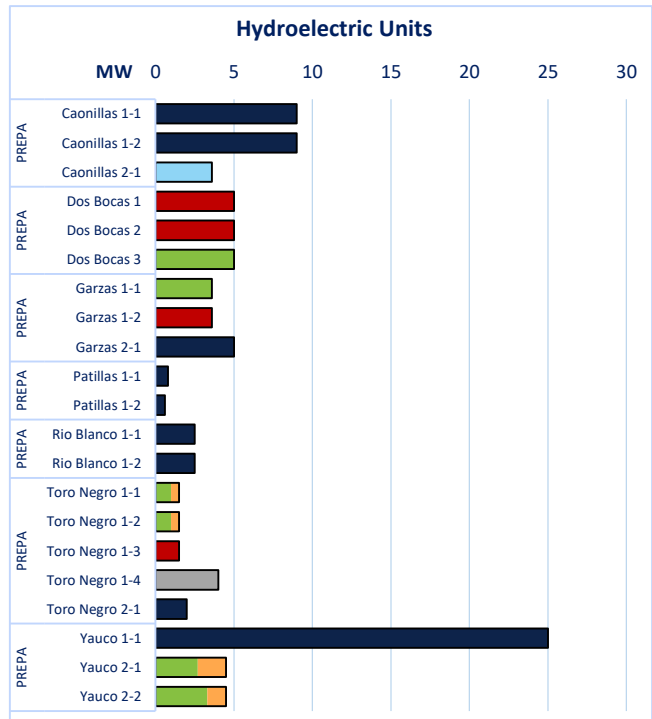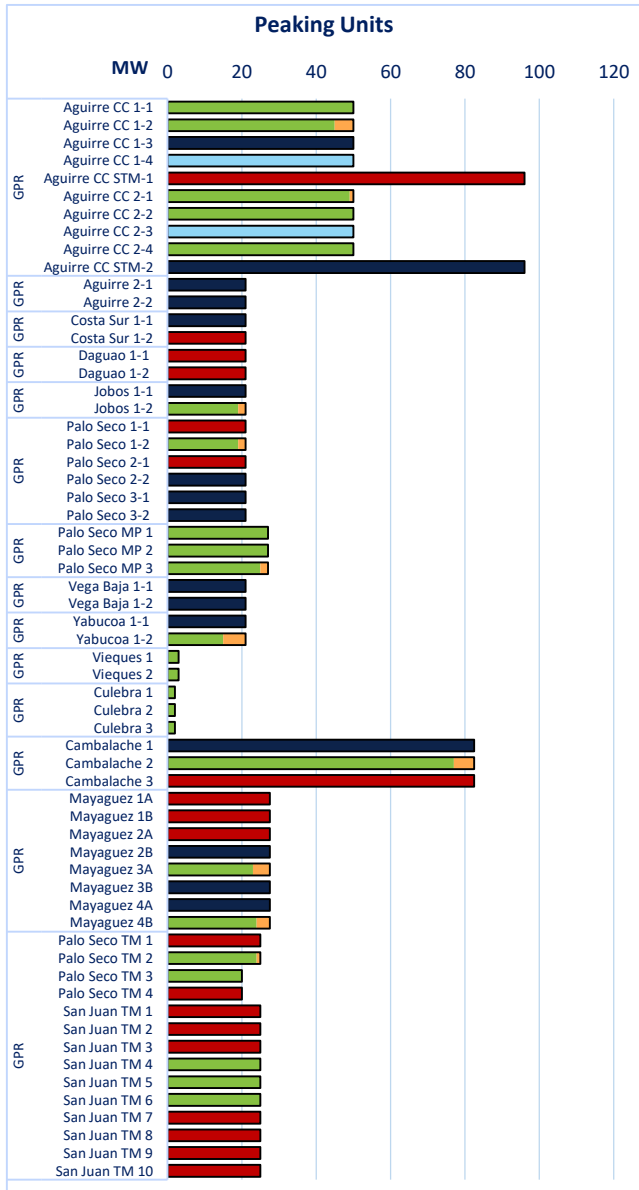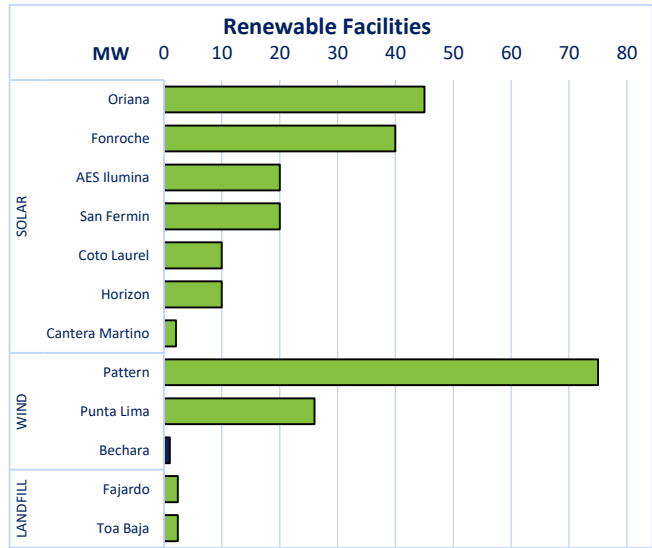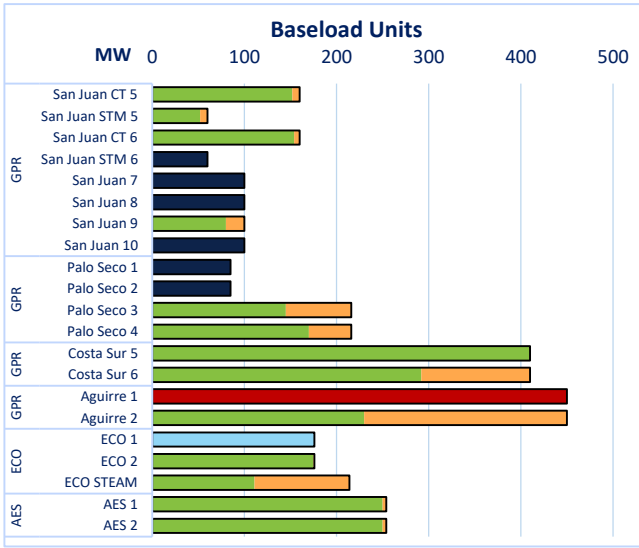

DAILY GENERATION AVAILABILITY REPORT

LUMA is not responsible for generation and is providing this report as part of service to our customers.
The report shows the availability generation as reported daily by each generator.

PLANNED AND MAINTENANCE OUTAGES

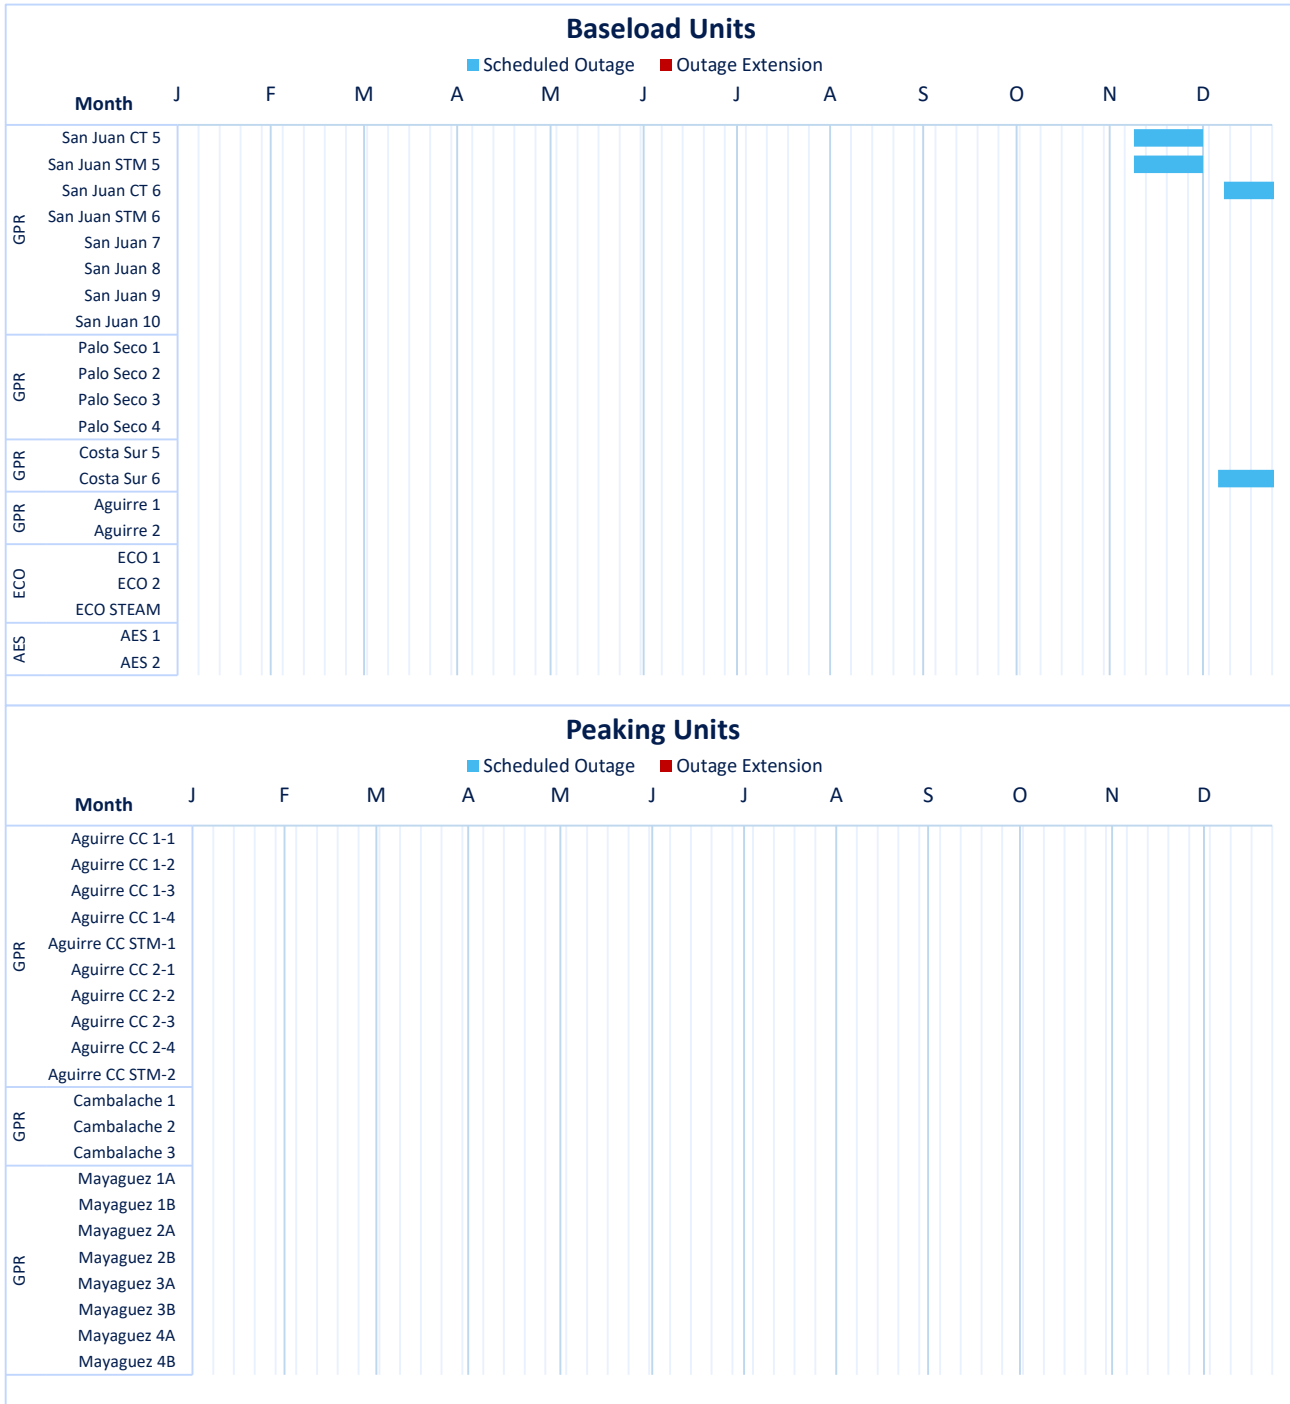

REFERENCED TERMS:

Peak Demand is the anticipated highest demand at a certain point of the day.

The Required Reserves are determined daily depending on the largest unit in the system.

Available Reserves represent the difference between the total electricity available from the generators and the current electricity demand from customers. Reserve levels can change throughout the day as the available electricity from the generators increases or decreases, or depending on the amount of electricity customers are using. Green indicates the Required Reserves will be met; red indicates the reserves will be below the Required Reserve level.

Reserves Shortfall are the difference between the Required Reserves and the Current Reserves.

Available Supply means the available electricity that will be generated by the generators. The Available Supply shown in the System Availability Graphs do not include Solar, Wind, or Landfill.

Availability Rate is calculated as Available Capacity / Nameplate Capacity, where Nameplate Capacity is the maximum output of a generator as designed by the manufacturer.

Limitations represent the reduction of electricity that can be generated by the generators. These Limitations are established by each generator.

Outages represent the reduction of electricity that can be generated by the generators due to the unavailability of a unit, or various units. These outages can be scheduled or unscheduled.

Out-of-Service represents units that have been unavailable for a period of 12 months or longer.